


[illegible]

DN	DN50-DN1600
PN	10/16bar
□□□□□ □□□□	□ 80 °C
□□□□□	□□□
□□□□ □□□□	BS5153 □ DIN3202 F6



APPLICATION SCENARIO

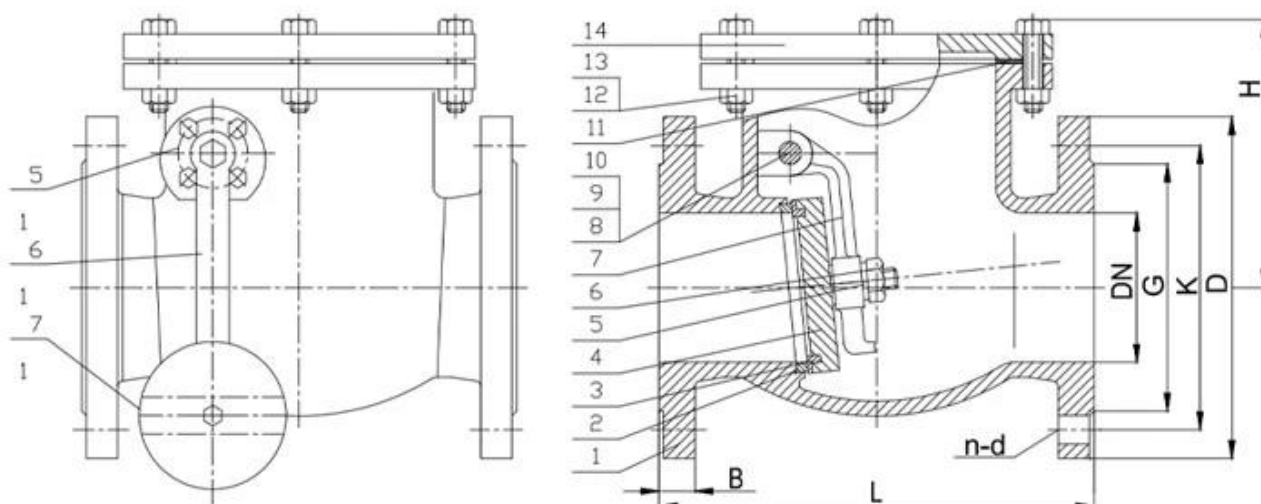

Industrial water application



Power plant



Sea water desalination



Water treatment



Water supply and drainage



HAVC



Food and drug



Water transport



A diagram of a horizontal beam of length L . A triangular load is applied downwards, starting at 0 at the left end and increasing linearly to a peak value of w_0 at the right end. A reaction force R is shown at the right end, pointing upwards.



i 000000 000000 000000000000 00000000 00 000000 000000 :000000 0000.

[illegible]

□□□□ □□ □□□□□□ □□□□ □□□□ □□□□ □ □□□□□□□ □ □□□□ □□□□ □□□□ □□□□ □□□□.

iv □□□□□□ □□□□□□ □□ □□□□□ □□□□□□ □□□□□□ □□□□□□ □□□□□□.

v **certifikát** **certifikát**: GB **German Standard** **American Standard** **Tuv CE** **ISO 9001** **ADWO-2000** **TS** **PED** **WRC WRAS** **KTW** **API 6D** **API609**.

0000000 0 0000 00000 0 00000000 00000 0 000000 00000 0 000000000 00000 :00000000 00000000 00000000
 .0000000 000000 0 000000000 / 0000000 / 00000 00000 0 0000000000 00000000 0 000000000 000000



COMPANY EXHIBITION



COMPANY QUALIFICATION



Partners



Delivery



Payment



:
:

RKSfluid
 " " :.

:
 RKSfluid .
 .

" :
 : RKSfluid .

:
 . 5 ~ 2

:
 1 :pc .

:
 . 100 :
 TUV API WRAS CE ISO.
 DIN ASME BS EN JIS API AWWA.

:

□: RKSfluid □□□□ □□□□□ □□□□□□ □□□□ □□□□□ 70 □ □□□□ □□□□□□ □□ □□□□ 27 □□□□
□□ □□□□□□ □□□□□ □□□□□□ □□□□□□ □□□□□.