

.



.

.

.

.

.

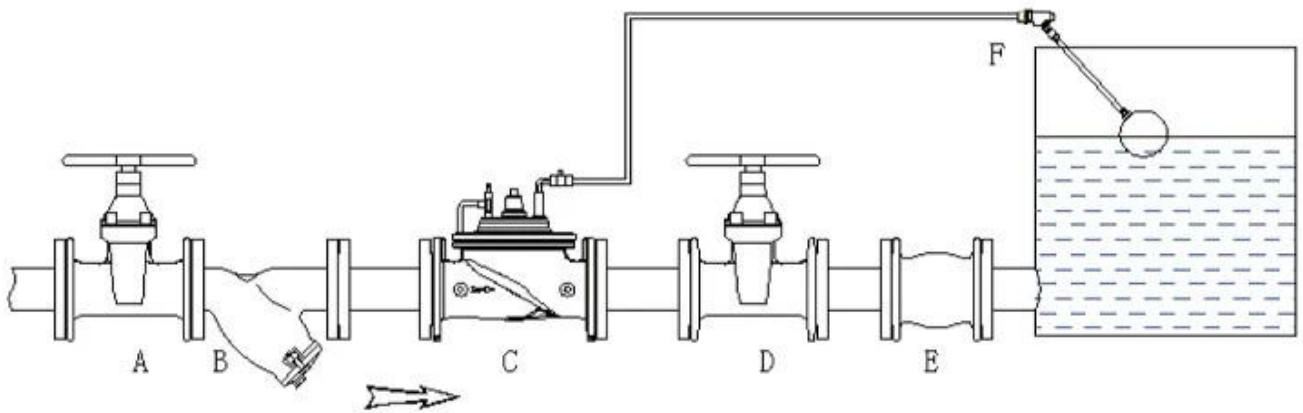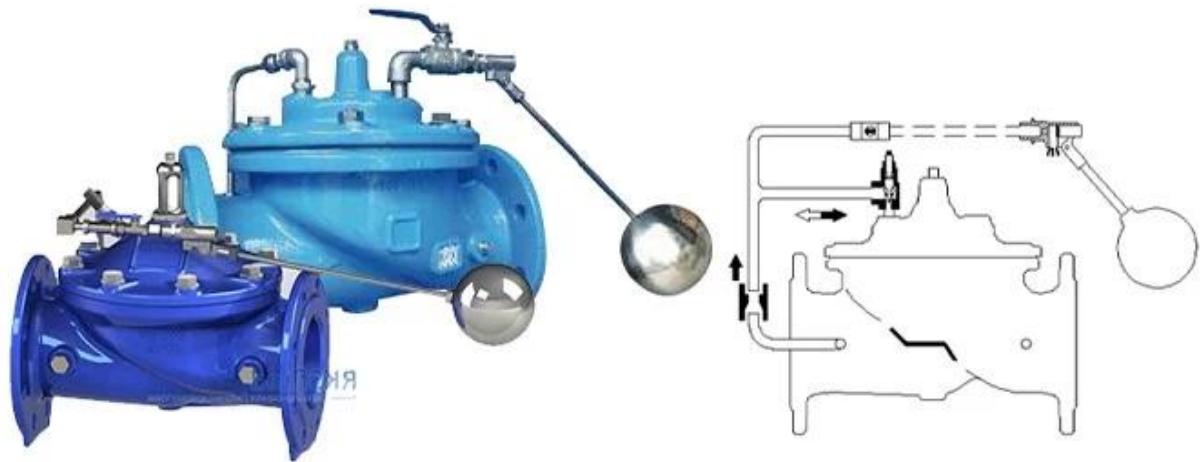

A. Shut off valve B. Y strainer C. Float control valve D. Shut off valve E. Soft joint F. Float pilot

-
- -
- HVAC
-
- -
- -
- -

COMPANY FACTORY



01

21 years of professional experience

03

Independent research and development team
28 top senior professional researchers

05

100% high level ex-factory inspection

07

2 years quality assurance, repair and replacement

4 factories

02

2 professional testing centers

04

High quality imported materials

06

COMPANY QUALIFICATION



COMPANY EXHIBITION



A: RKSfluid 00000000 000000 000000 00000000 0000000000 000000 00000000 70 00 000000 000000 20 000000 00000000
00 00000000 0000000000 00000000.