



DESIGN FEATURES

TECHNICAL REQUIREMENT

- 1.Design standard:BS 5163.
- 2.Face to face:BS 5163.
- 3.Flanges standard:BS EN1092-2:1997 PN16.
- 4.Test standard:BS EN12266-1 Rate B.

FEATURES

- Double flange metal seated gate valve
- Size Range:DN50-DN2000
- Standard-ISO/BS/DIN/AWWA/API
- Tests Standard-BS EN 12266-1
- Body Ring-Bronze/SS420/SS304/SS316
- Body-Ductile Iron /Cast Iron/Stainless Steel /WCB
- Fusion bonded epoxy coating-min 300 microns

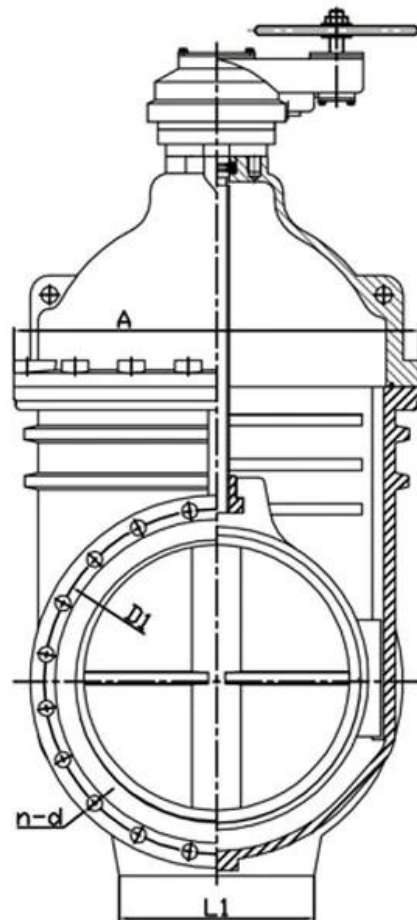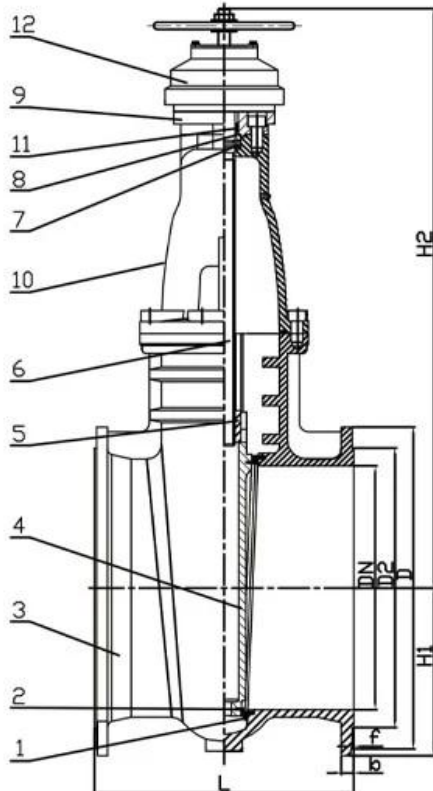

RELATED PRODUCTS



SMALL DIAMETER GATE VALVE
DN50-DN300,PN10/16/25



METAL SEATED GATE VALVE
DN350-DN600,PN10/16/25



LARGE DIAMETER
METAL SEATED GATE VALVE
DN700-DN2000,PN10/16/25

APPLICATION SCENARIO



Industrial water application



Power plant



Sea water desalination



Water treatment



Water supply and drainage



HAVC



Food and drug



Water transport



COMPANY FACTORY





- i 000000 00000 0000000 000000000000 000000 00 000000 000000 :0000000 0000.
- ii 00000 00000 CNC 0 00000 0000000 000000 000000 0 0000000 000000000 0000000 0 000000000 00000000 000000000 0000000 00000.
- iii 000 000000000 00000 0000000 00000 00 000000000 0 000000 00 000000000 000000000 0000000 000000.
- iv 00000000 000000000 00 0 00000 0 0000000 00 000000000 000000 0000000 0000000.
- v 0000000 000000: GB 0 German Standard 0 American Standard 0 Tuv CE 0 ISO 9001 0 ADWO-2000 0 TS 0 PED 0 WRC WRAS 0 KTW 0 API 6D 0 API609.

0000000 0 000 0000 0 00000000 0000 0 000000 0000 0 00000000 0000 :00000000 00000000 0000000
 0000000 000000 0 00000000 / 000000 / 0000 0000 0 0000000000 00000000 0 00000000 000000.

01

21 years of professional
experience

03

Independent research and
development team
28 top senior professional
researchers

05

100% high level ex-factory
inspection

07

2 years quality assurance,
repair and replacement

4 factories

02

2 professional testing
centers

04

High quality imported
materials

06

COMPANY QUALIFICATION



COMPANY EXHIBITION



○○○○○○○○○

○○○○○○○○○ ○○○○ ○○○○○○○○○○ ○○ ○○○ ○ ○○○○○○○○ ○○○○ ○○○○ ○○○○ ○○○○ :○

A: ○○○○○○○○ ○ ○○○○○○ ○ ○○○○○○○○ ○○○○ ○ ○○○○○○○○○○ ○○○○.○○○○○○○○○○○ ○○○○ ○

○○○○○ ○○○○ ○ ○○○○○○○○○○ ○○○○○○ ○○○○○○ ○○ :○

A: ○○○○○○○○ ○○○○○○ ○○○○○○ ○ ○○○○○○○○○○ ○ ○○○○○○○○○○. RKSfluid ○○○○○○○○ ○○○○○○○○○○ ○○○○○○ ○○○○○○○○○○
 .○○○○○○○ ○○○○ ○ ○○○○○○ ○○○○ .○○○○○○○○○○○ ○○○○○○○○

○○○○○○○○○○○ ○○○○○○ ○○ ○○ :○

○○○○○ :○ RKSfluid .○○○○○○○○○ ○○○○ ○○○○○○○○○○ ○○○○ ○○ ○○○○ ○○○○○○ ○○○○○○ ○○○○

○○○○○○○○○ ○○○○ :○

.○○○○○○○ ○○○○ ○○○○○○ ○○○○○○ .○○○ ○○○○ 5 ~ 2 ○○ ○○○○○○ ○○○○ ○○○○○○○○ ○○○○○○○○○○ :○

○○○ :○

1 :○pc .○○○○○○○○○○○ ○○○○○○

○○○○○○○○○ ○○○○ ○○ ○○○○ :○

.○○○○○○○ ○○ ○○○○○○ ○○○○○○ ○○ ○○○○ .○○○○○○○ ○○○○ ○○○○ ○ ○○○○○○○○ ○○○○ ○ 100 ○○○○○○ ○○○○○○○○ :○

○○○○○○○ ○○○○ ○○○○○○ TUV ○ API ○ WRAS ○ CE ○ ISO.

○○○ ○○○○○○○○ ○○○○○○○○ DIN ○ ASME ○ BS EN ○ JIS ○ API ○ AWWA.

○○○○○○○○○○○ ○○○○○○○○ ○○○○○○ ○○○○○○ ○○○○○○ ○○○○○○ ○○○○ :○

A: RKSfluid ○○○○○○○○ ○○○○○○○○ ○○○○○○○○ ○○○○○○○○ ○○○○○○○○ ○○○○○○○○ 70 ○○ ○○○○○○ ○○○○○○ 20 ○○○○○○ ○○○○○○○○
 ○○ ○○○○○○○○ ○○○○○○○○○○ ○○○○○○○○○○.