

. . . . .



. . . . .

. . . . .

. . . . .

. . . . .

. . . . .

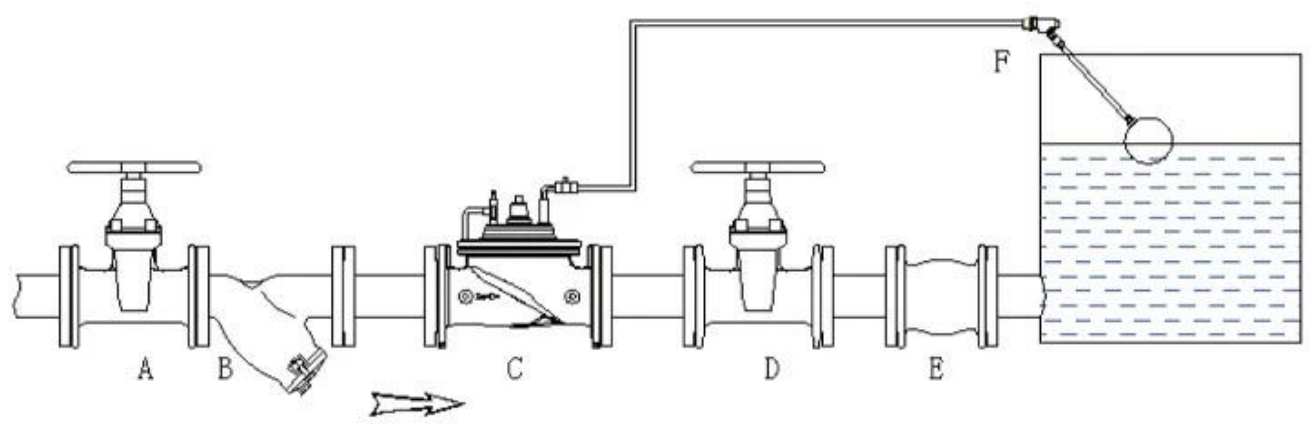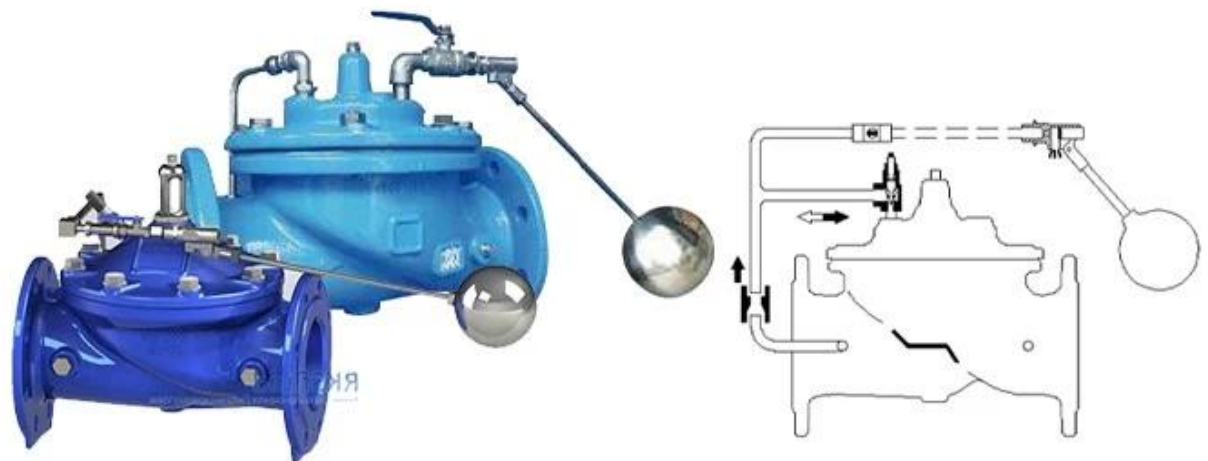

A. Shut off valve   B. Y strainer   C. Float control valve   D. Shut off valve   E. Soft joint   F. Float pilot

- . . . . .
- . . . . . -
- HVAC
- . . . . .
- . . . . . -
- . . . . . -
- . . . . . -





# COMPANY FACTORY



01

21 years of professional experience

03

Independent research and development team  
28 top senior professional researchers

05

100% high level ex-factory inspection

07

2 years quality assurance, repair and replacement

4 factories

02

2 professional testing centers

04

High quality imported materials

06

## COMPANY QUALIFICATION



## COMPANY EXHIBITION





A: RKSfluid 00000000 000000 000000 00000000 0000000000 000000 00000000 70 00 000000 000000 20 000000 00000000  
00 00000000 0000000000 00000000.