
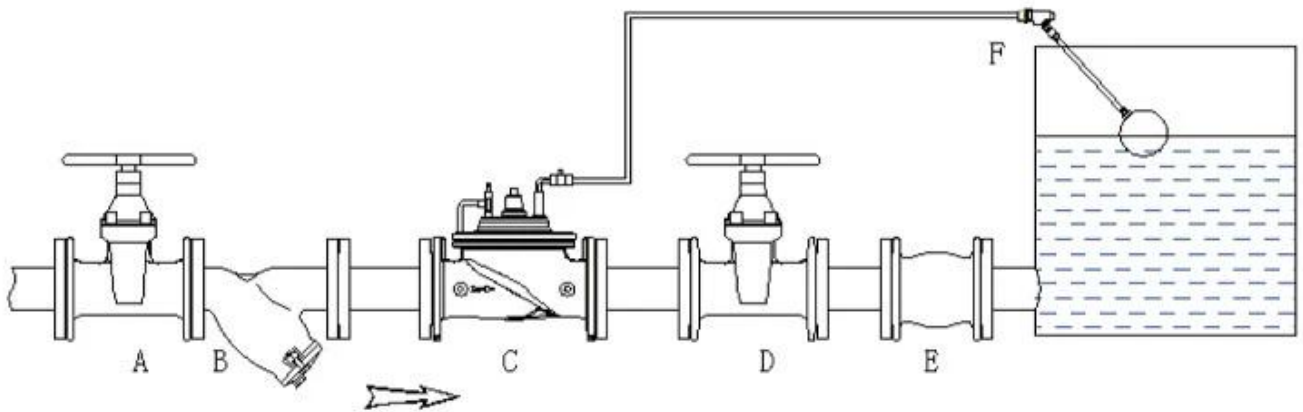


□□□□□□□□□□□□

□□□□□□□□□□□□□□□□□□□□□□□□□□□□

□□□□□□□□□□□□□□□□□□□□

□□□□□□□□□□□□□□□□□□□□

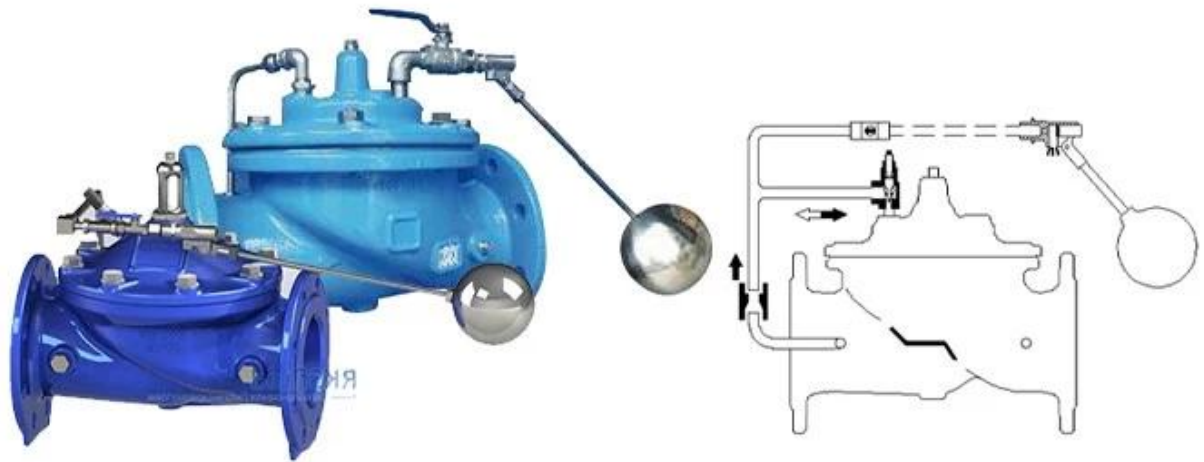

A. Shut off valve   B. Y strainer   C. Float control valve   D. Shut off valve   E. Soft joint   F. Float pilot

□□□

- □□□

-HVAC

- □□□□

- □□

- □□□□□

- □□

- □□

- □□/□□□□

|        |                    |
|--------|--------------------|
| □□     | DN40-DN1200        |
| □□□□□□ | □                  |
| □□     | 0°C□70°C           |
| □□     | □□□/□□□□/□□□□/□□□□ |

| Dn  | l   | H   | H1  | Dn   | l     | H    | H1  |
|-----|-----|-----|-----|------|-------|------|-----|
| 40  | 230 | 139 | 85  | 250  | 730   | 476  | 205 |
| 50  | 230 | 139 | 85  | 300  | 850   | 526  | 232 |
| 65  | 290 | 159 | 95  | 350  | 980   | 585  | 262 |
| 80  | 310 | 179 | 102 | 400  | 1100  | 624  | 292 |
| 100 | 350 | 214 | 112 | 500  | 1250  | 720  | 360 |
| 125 | 400 | 278 | 127 | 600  | 1450  | 835  | 424 |
| 150 | 480 | 333 | 145 | 800  | 1850□ | 1110 | 515 |
| 200 | 600 | 407 | 172 | 1000 | 2250  | 1350 | 630 |



# COMPANY INFORMATION



i. 公司基本情况

ii. CNC 加工精度

iii. 质量管理体系

iv. 检测设备

v. 符合 GB 标准，TUV CE，ISO 9001，ADWO-2000，TS，PED，WRC WRAS，KTW，KTW，API 6D，API609

VI. 公司资质 / 证书 / 认证

# COMPANY FACTORY



01

21 years of professional experience

03

Independent research and development team  
28 top senior professional researchers

05

100% high level ex-factory inspection

07

2 years quality assurance, repair and replacement

4 factories

02

2 professional testing centers

04

High quality imported materials

06

## COMPANY QUALIFICATION



## COMPANY EXHIBITION



## Partners



### Delivery



### Payment



□□□□

□□□□□□□□□□□□□□□□□□□□

□□□□□□□□□□□□□□□□□□□□

□□□□□□□□□□□□□□□□

□□□□□□□□hrdraulic□□□□□□RKSfluid□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□

□□□□□□□□□□

□□RKSfluid□□□□□□□□□□□□

□□□□□□□□

□□□□□□□2□5□□□□□□□□□□□□□□□□□□

□□□□

□□□□□□□1□□

□□□□□□□□□□

□□□□□100□□□□□□□2□□□□□□□□□□□□□□

□□□□□TUV□API□WRAS□CE□ISO□□□□

□□□□□DIN□ASME□BS EN□JIS□API□AWWA□

□□□□□□□□□□□□□□□□□□

□□RKSfluid□□20□□□□□□□□70□□□□□□□□□□□□□□□□□□□□□□