[illegible]OS[illegible]Y[illegible]

[illegible]	EN 1171
[illegible]	EN 1092-2
[illegible]	EN558-1[illegible]3/14/15
[illegible]	EN 12266-1
[illegible]	[illegible]
[illegible]	[illegible]
[illegible]	0-80℃
[illegible]	11/18/28BAR
[illegible]	15/24/38bar
pn	10/16/25Bar
size	DN40-DN500

[illegible]

- [illegible]CWC[illegible]

- [illegible]

- [illegible]

-Gland[illegible]SS304[illegible]

-O[illegible]

- [illegible]100[illegible]

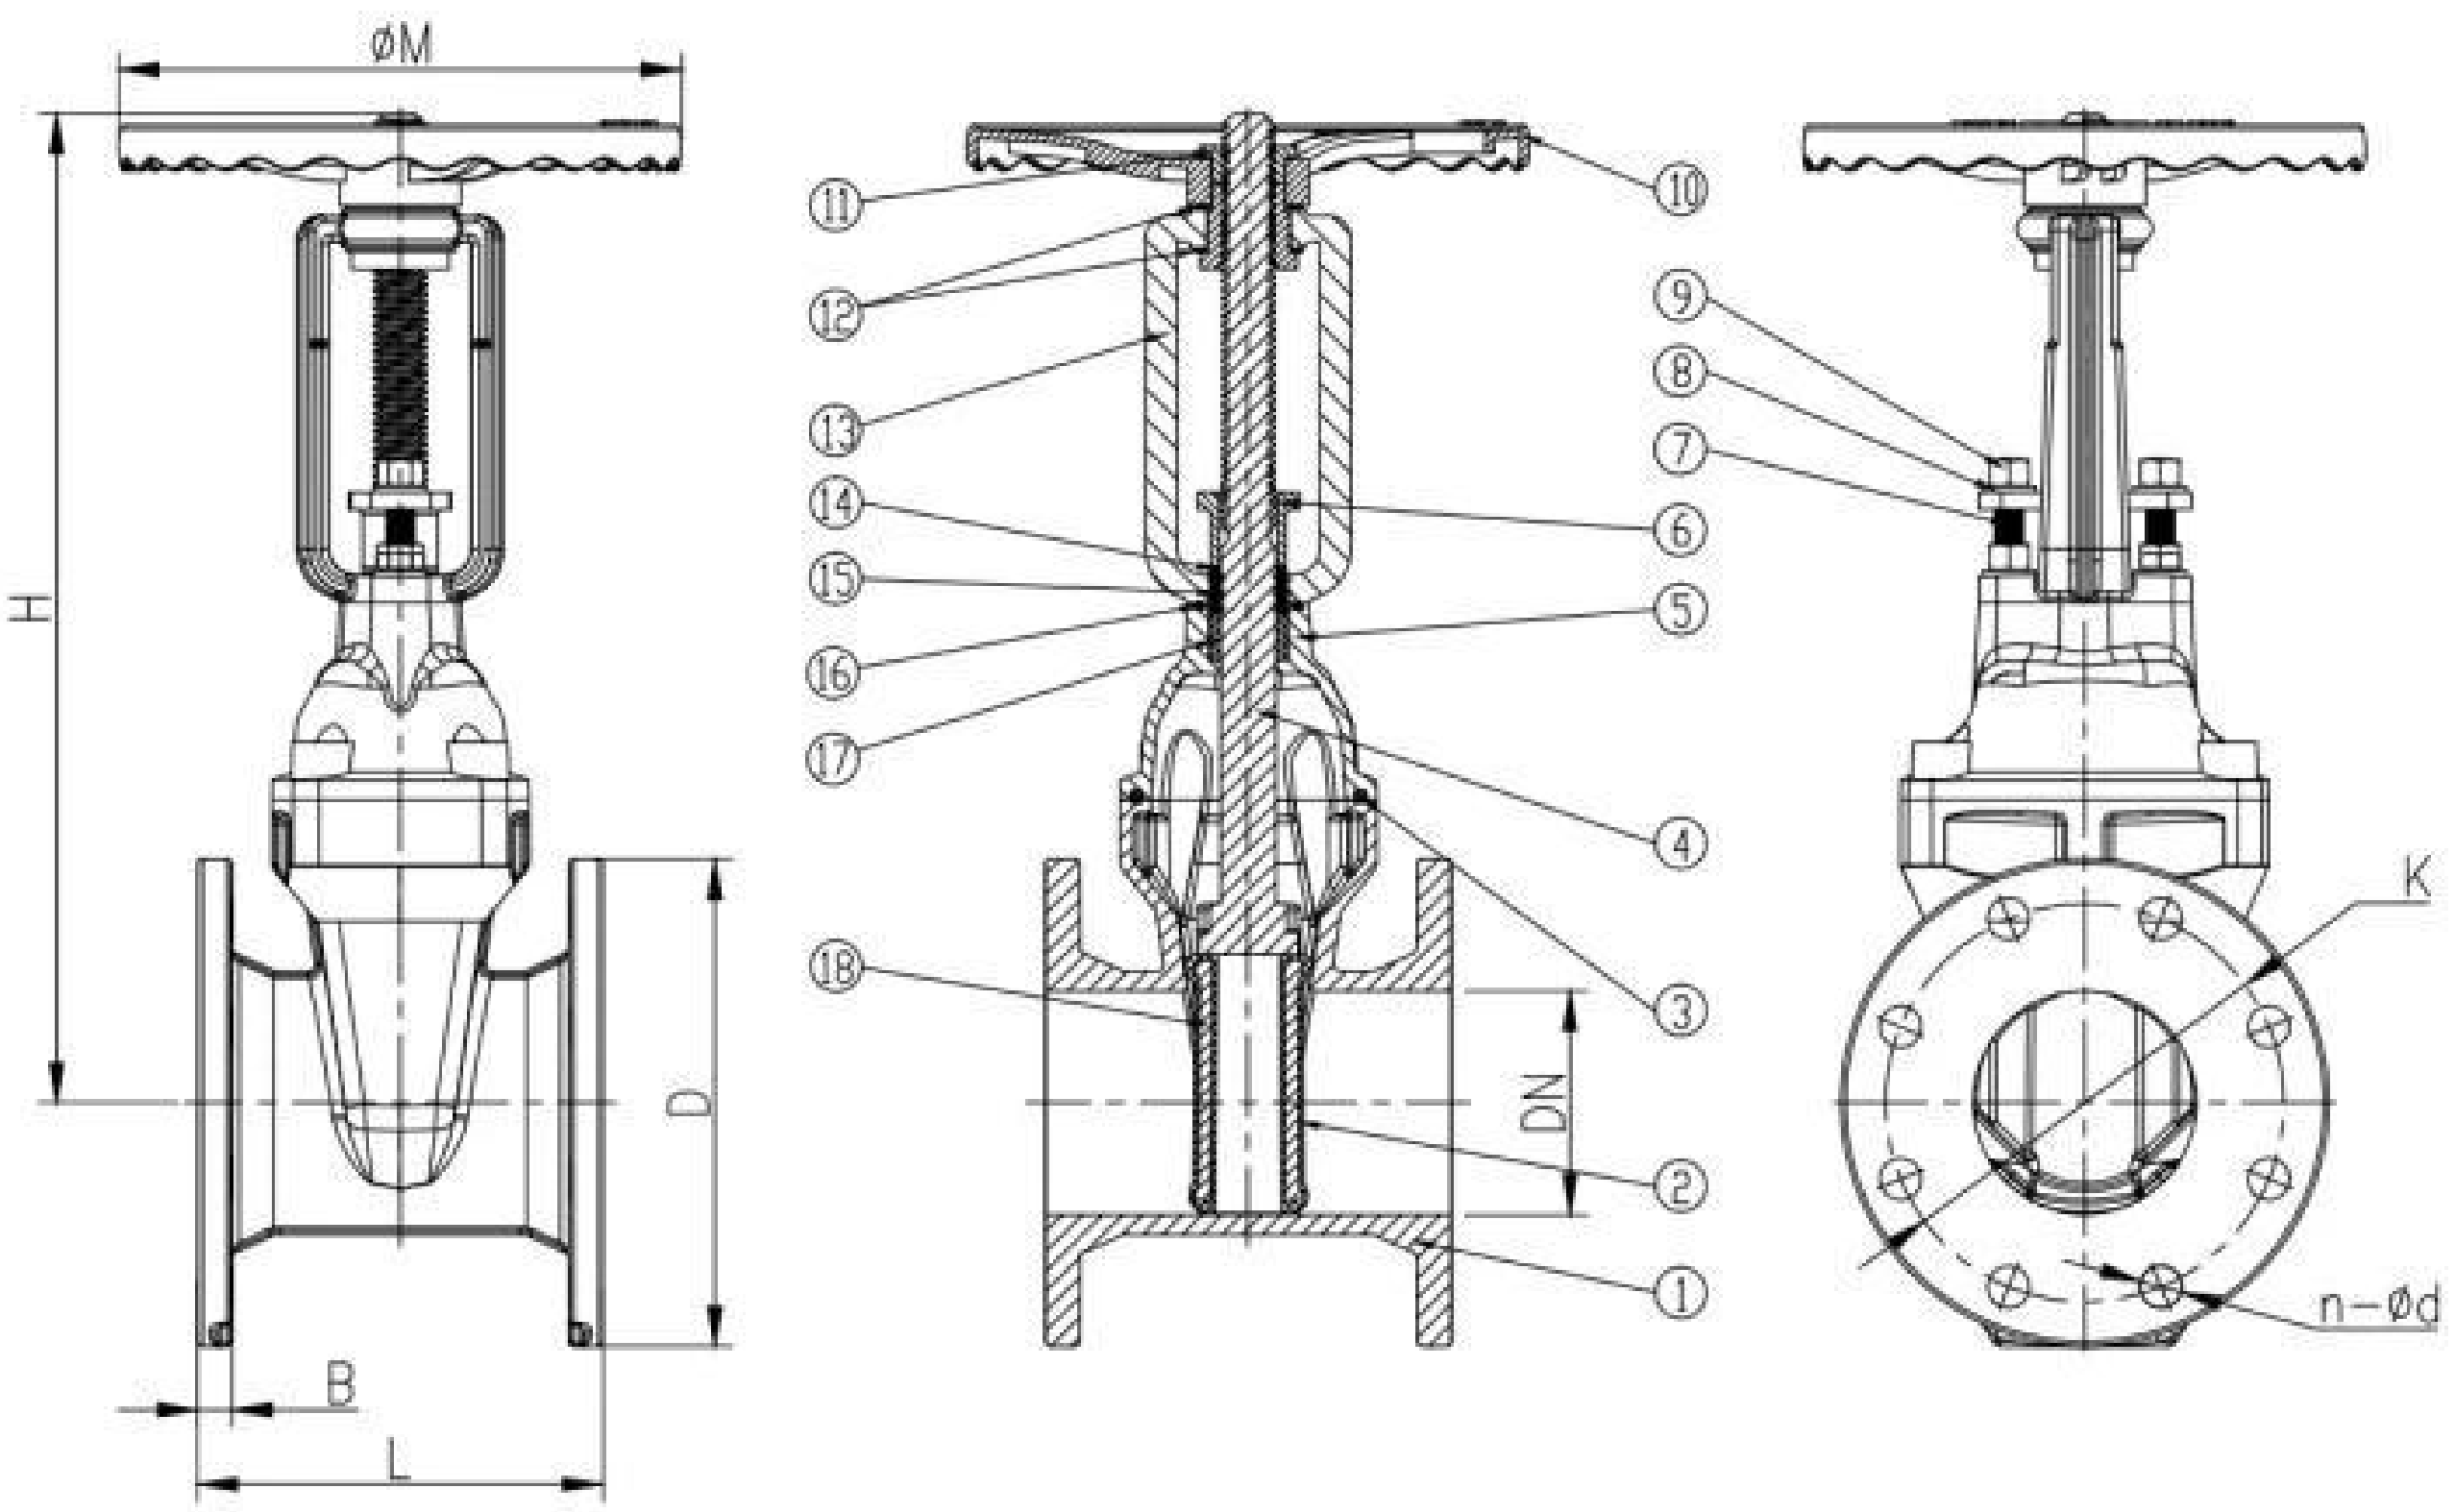

APPLICATION SCENARIO

Industrial water application | Power plant | Sea water desalination | Water treatment | Water supply and drainage | HAVC | Food and drug | Water transport

COMPANY FACTORY

COMPANY INFORMATION

i□□□□□□□□□□□□□□□□□□□□□□

divanced Advanced CNC Machining Center□Professional Process Cells□□□□□□□□□□□□□□□□□□□□□□

china□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□

cention□□□□□□□□□□□□□□□□□□□□□□□□□□□□

v□□□□GB□□□□□□American Standard□Tuv CE□ISO 9001□ADWO-2000□TS□PED□WRC WRA□KTW□API 6D□API609□

VI□□ /□□□ /□□□□□□□□□□□□□□□

01
21 years of professional experience
02
4 factories
03
Independent research and development team
28 top senior professional researchers
04
2 professional testing centers
05
100% high level ex-factory inspection
06
High quality imported materials
07
2 years quality assurance, repair and replacement

COMPANY QUALIFICATION

COMPANY EXHIBITION

Partners

TALIS
GEMÜ
WATTS
Bray
hawle
amri
BAYARD
AVK
EBRO
KEYSTONE
EMERSON
GIBSON
CAMERON
CMO VALVES
SWISS fluid
SAINT-GOBAIN
KSB
tyco
TTV
SAPAG
haike

faq

Q□□□□□□□□□□□□□□□□□□□□□□□□□□□□
A□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□

Q□□□□□□□□□□□□□□□□□□□□
A□□□□□□□□□Hrdraulic□□□□□□□□□□□RKSfluid□□□□□□□□□USA□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□

Q□□□□□□□□□□□□□□□□□
A□RKSfluid□□□□□□□□□□□□□□□4□□□□□□□□□□□

Q□□□□□□□□□□
A□□□□□□□□□2□5□□

Q□Moq
A□□□□□□□□□1PC□

Q□□□□□□□□□□□□□
A□□□□□100□□□□□□□□2□□□□□□□□□□□□□□□□□□□□□□□□
TUV□API□WRA□CE□ISO□□□□□□□□□□□
Standard□□DIN□ASME□BS EN□JIS□API□AWWA□□□□□□□□□□

Q□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□
A□RKSfluid□□□20□□□□□□70□□□□R□D□□□